



SINGLE CKT  
REMOTE CONTROL  
CONNECTION

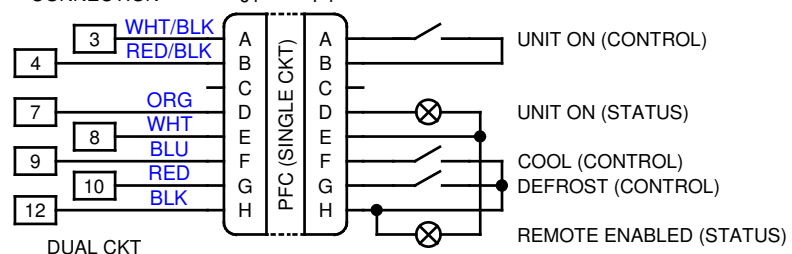

DUAL CKT  
REMOTE CONTROL  
CONNECTION

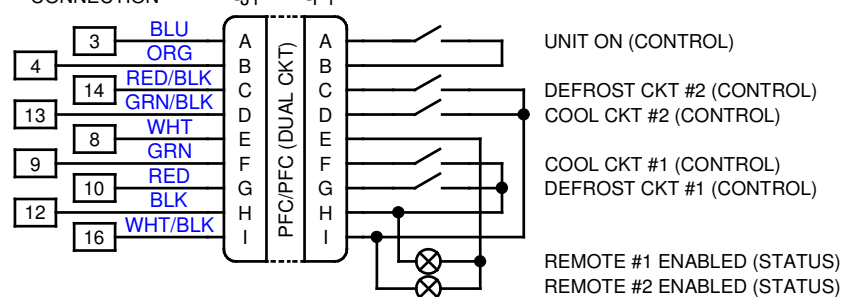

Notes:

1. Compressor can utilize either 2 or 3 overloads for over current protection.
2. PFC Module CKT#2 is only present on dual circuit (PFC/PFC) units.
3. Buffer Valve/Timer circuit is present on 1000 series units only.
4. Remote Control is via a non-isolated 24 VAC system bus.

COPYRIGHT © M&T SYSTEMS 2008. ALL RIGHTS RESERVED.  THIS DOCUMENT MAY BE COPIED AND FURNISHED TO OTHERS WITHOUT RESTRICTION OF ANY KIND, PROVIDED THAT THE ABOVE COPYRIGHT NOTICE, AND THIS PARAGRAPH, ARE INCLUDED ON ALL SUCH COPIES AND DERIVATIVE WORKS.			
		1845 Piner Road Santa Rosa, CA 95403 (707) 569-7380	
<b>PFC-500/650/1000 ELEC CKT DIA</b>			
DRAWN/DATE <b>MSP 02/01/08</b>	SIZE <b>A</b>	DWG NO. <b>ELEC-1001-01</b>	REV <b>01A</b>
FILE: ELEC-1001-01.doc			SHEET: 1 OF 1